


LON digital input modules

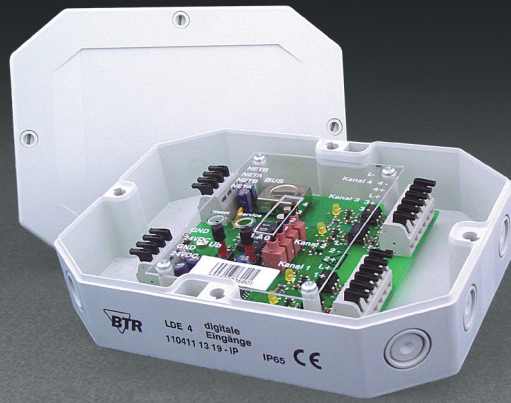


LDE 4 IP65

24 V AC/DC, 4 contact inputs


Part Number

110 411 13 19-IP


Dimensions - IP65 housing



Wiring



Wiring Diagram



Use

LON module with 4 digital inputs. Suitable to record the status of potential free switches, e.g. electronic limit switches at vent valves or auxiliary contacts at power contactors.

Functional description

Depending on the position of the jumper J the inputs can be used as contact and voltage inputs (A1, 24 V AC/DC, Jumper J - A2, factory setting) or with actuation to GND (A2, Jumper J - A1). In a LON installation these data points can be bound individually or as a whole.

LON interface

transceiver	FTT10A free topology
neuron	3120, 2k EEPROM
data format	standard network variables (SNVT)
transmission rate	78 kBit/s
max. length (see page 7)	
line topology	2700 m / 64 nodes
free topology	500 m / 64 nodes
cabling	twisted pair

Application software

XIF and NXE files are available as downloads under www.btr-electronic-systems.de.

Technical data

Housing

dimensions w*h*l	159 x 41.5 x 120 mm
weight	300 g
mounting position	any
mounting position	any
mounting	directly to a smooth surface
	8 cable entries for M12 and M16 fittings
material	housing ASA+ polycarbonate
	terminal blocks polyamide
	cover polycarbonate
	IP65

Terminal blocks

type of protection (DIN 40050)	IP65
supply and bus	1.5 mm ² pluggable
	jumper plug (included to packing)
digital inputs	2.5 mm ²

Supply

operating voltage range	20 ... 28 V AC/DC
current consumption	63 mA (AC) / 21 mA (DC)
duty cycle	100 %
recovery time	550 ms

Temperature range

operation	-5 °C ... +55 °C
storage	-20 °C ... +70 °C

Protective circuitry

operating voltage polarity reversal protection


Display

operation	green LED
function	yellow LED for status (service)
input status	yellow LEDs

LON digital input modules

Description of the LonMark objects and network variables

LDE 4
LDE 4 IP65

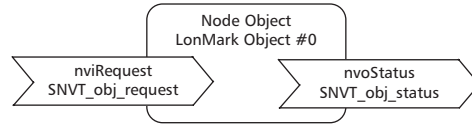


Node Object

The Node Object monitors and controls the functions of the different objects in the device. It supports the basic functions Object-Status and Object-Request required by LonMark.

Application Objects

The objects contain the functions status record of the digital inputs and data exchange.

DigitalIn Object

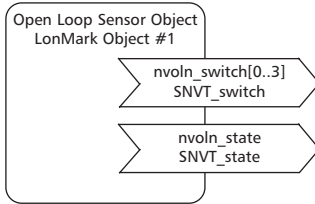

DigitalIn Object


nvoln_switch[0..3] (index 2..5)

SNVT type SNVT_switch
Function Status of the inputs. The output variables are issued after a change of the input status, at the end of the preset obligatory update time (nciMinSendTime) or after a module reset.
Closed contact nvoln_switch[0..3] = 100.0 1
Open contact nvoln_switch[0..3] = 0.0 0

nvoln_state (index 6)

SNVT type SNVT_state
Function Status of the inputs. The output variable is issued after a change of the input status, at the end of the preset obligatory update time (nciMinSendTime) or after a module reset.
Assignment nvoln_state.bit0 = input 1 ... nvoln_state.bit3 = input 4
Closed contact nvoln_state.bit[0..3] = 1
Open contact nvoln_state.bit[0..3] = 0

Configuration Variables



Configuration Variables

nciMinSendTime (index 7)

SNVT type SNVT_count
Function The output variables nvoln_switch and nvoln_state are issued after a preset period of time even without a change of the input status.
Time settings 0 timer turned off
1 .. 60 timer period in seconds (factory setting 0)

nciMessZeit (measuring time) (index 8)

SNVT type SNVT_count
Function The status of the inputs are scanned within the preset time. Then the output variables nvoln_switch and nvoln_state are set and issued at the end of the preset update time (nciMinSendTime).
Time settings 0 timer turned off
120 ... 60,000 timer period in ms (factory setting 0)

nciInvertOutput[0..3] (index 9..12)

SNVT type SNVT_lev_disc
Function inversion of the input signal
nciInvertOutput[0..3] = ST_ON open input contact; nvoln_switch and/or nvoln_state = set
nciInvertOutput[0..3] = ST_OFF closed input contact; nvoln_switch and/or nvoln_state = set